


FOR CUSTOMER SUPPORT
864-859-4013

RECOMMENDED - CHECK WITH COUNTY CODES

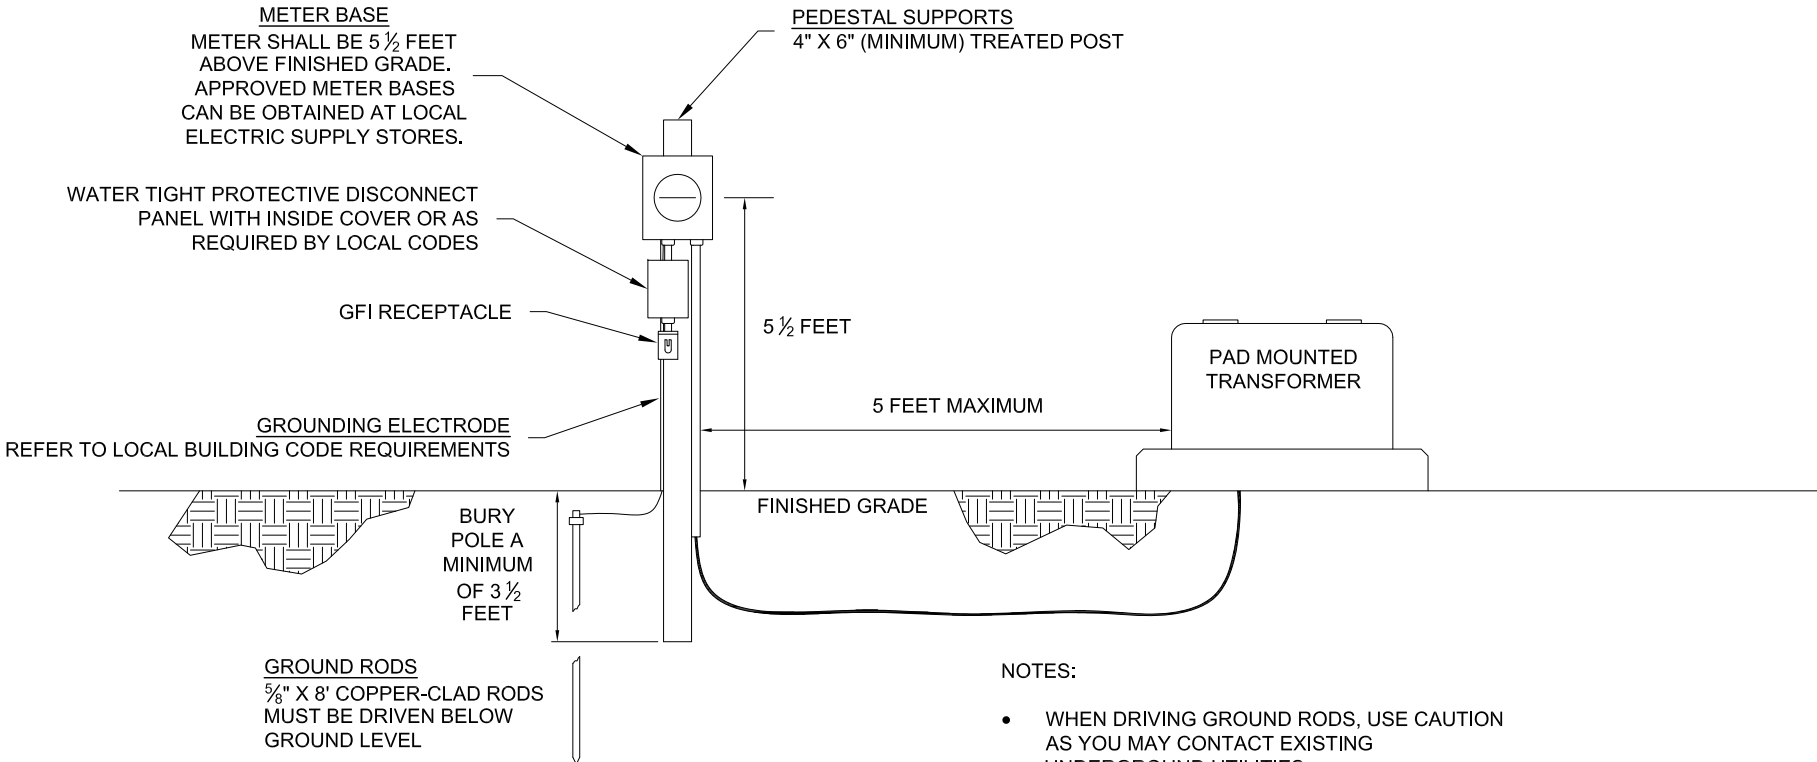

- NOTES:
- WHEN DRIVING GROUND RODS, USE CAUTION AS YOU MAY CONTACT EXISTING UNDERGROUND UTILITIES
 - FOR UNDERGROUND SERVICE, DO NOT LOCATE SERVICE POLE CLOSER THAN FIVE FEET FROM PADMOUNT TRANSFORMER

SERVICE ENTRANCE MINIMUM REQUIREMENTS

TEMPORARY LOADS WITH UNDERGROUND POWER SOURCE

